



BMICH Guidelines for Activity Organizers

Electrical Safety

1. Stall wiring should be done by using recommended wires gauges, as below.

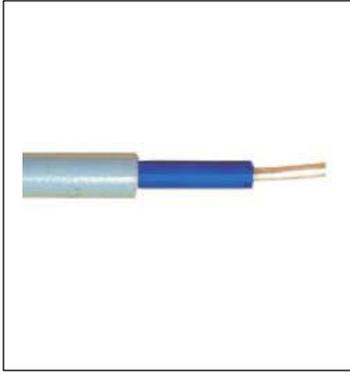


1/1.13 mm (1 mm²)

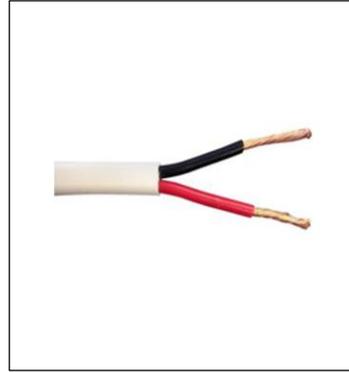

24/0.20 mm² 2 core (2x0.75mm²)




7/0.53 mm TF 2 core (2x1.5mm²)

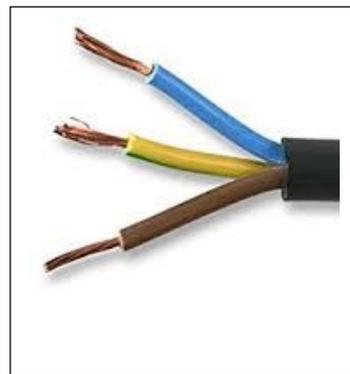

30/0.25 mm² 3core (3x1.5mm²)

Following Wire gauges are not allowed,

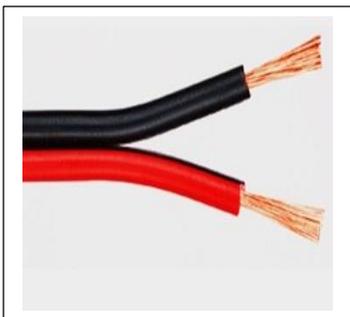

Flat twin 2 core 0.5mm²



2 core 0.5mm² TT

2. Sub- distribution panels should be equipped with protection devices to eliminate the Electrical hazard and the panels should be properly located and closed in order to ensure the safety of the Occupants.
3. Wires should be laid using protective conduits and pathway crossings should be laid by using ramp conduits to eliminate the electrical hazard and fall hazards.
4. It is recommended to use LED spot lights and avoided halogen as much as possible.
5. Wiring arrangements should be laid in order to ensure the phase balance.

Fire & Safety

1. Use of active flames are not permitted inside the halls.
2. Highly flammable liquids and gases are not permitted to use or keep inside the halls.
3. Stall layouts plans should be authorized by the BMICH fire & safety officer prior to the activity.
4. Existing Firefighting equipment's should not be barricade in any circumstances without taking prior approval from the BMICH authorities in writing.
5. Use of welding machines in-side the halls are not permitted
6. Emergency fire Exit path should not be barricade
7. Erection and dismantling of temporary canopies should be done by using personal protective equipment's and hazard lines to barricade the area.
8. Fire vehicles access roads should not barricade.

Waste management

1. BMICH practices the Zero waste strategy to minimize the carbon foot print by its business activities, therefore, we are highly concern of Non- bio degradable materials such as Polypthine, Plastics, packing materials, etc.
It is advised all the Event organizers to make aware there customers to prevent taking of any of these materials as much as possible. If they had then those materials should be taken out side after the event.
2. Use the color coded waste collection bins.
3. Fabrication of stalls should not be done in the BMICH premises only minor adjustments are allowed.